

EVALUATION REPORT

(As Per Rule 35 of PP Rules, 2004)

| | |
|----------------------------------|--------------------------|
| 1. Name of Procuring Agency | LESCO |
| 2. Method of Procurement | Single Stage One Envelop |
| 3. Title of Procurement | Earth Resistance Tester |
| 4. Tender Inquiry No. | 4141 |
| 5. PPRA Ref. No. (TSE) | TS555965E |
| 6. Date & Time of Bid Closing | 25.02.2025 10.30 a.m. |
| 7. Date & Time of Bid Opening | 25.02.2025 11.00 a.m. |
| 8. No of Bids Received | Three |
| 9. Criteria for Bid Evaluation | As per Bidding Document |
| 10. Details of Bid(s) Evaluation | As under |

| Name of Bidder | Marks | | Evaluated Cost (Million Rs.) | Rule/Regulation/SBD*/ Policy/ Basis for Rejection/ Acceptance as per Rule 35 of PP Rules, 2004. |
|--------------------|---------------------------|---------------------------|------------------------------|--|
| | Technical (if applicable) | Financial (if applicable) | | |
| Unicom Corporation | -- | -- | 14.960 | Technically non-responsive as the sample of the bidder is not acceptable as per visual inspection committee report. |
| Sarwar Electronics | -- | -- | 29.000 | Technically non-responsive as the sample of the bidder is not acceptable as per visual inspection committee report. |
| Matiullah & Sons | -- | -- | 31.350 | Technically non-responsive Due to following reasons: 1. Offered model DYORITSU KEW 4105DL-H which supports both 3-pole and 2-pole Earth Resistance measurement, as per the technical data provided. However, it does not fulfil the technical requirement specified in PD:89:2003, Clause 2.2 which is reproduced as "Three or Four Terminal Measurement" 2. The offered model supports only 2-pole and 3-pole measurement, which compromises its suitability for soil resistivity testing. Measuring soil resistivity typically requires a 4-terminal method for accurate result. |

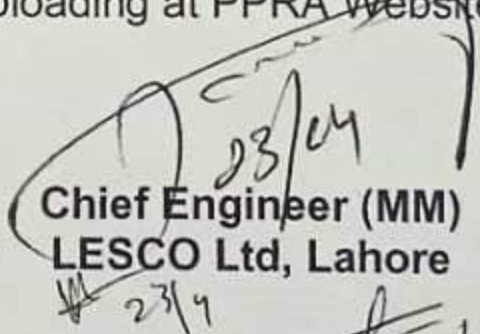
| | |
|--------------------------|--------------------------------------|
| Lowest Evaluated Bidders | None of the bidder responsive |
|--------------------------|--------------------------------------|

11. Any other additional / supporting information, the procuring agency may like to share.

Endst. No. 12459-62

Dated: 23-4-25

Forwarded to the Dy. Director, Public Procurement Regulatory Authority, 1st Floor FBC Building Near State Bank, Sector G-5/2, Islamabad for uploading at PPRA Website.


Chief Engineer (MM)
LESCO Ltd, Lahore

Info:

1. M/s Unicom Corporation, 1st Floor, Venus Plaza, 7-Egerton Road, Lahore
2. M/s Matiullah and Sons, Al-Hadi Plaza, Nothia Bazar, Peshawar Cantt.
3. M/s Sarwar Electronics, Ali Centre, 16-Hall Road, Lahore